


Reference No: 1/RO/21
 Sheet No: 1 of 2
 Scale: 1/100
 Date: APRIL 1988
 Drawn By: DJF
 Signature of Inspecting Officer: [Signature]
 Fire Certificate No: [Blank]
 This plan forms part of: [Blank]

Legislation: FIRE PRECAUTIONS ACT 1971

Address: RODNEY HOTEL
 RODNEY PLACE
 CLIFTON
 BRISTOL




W.P.	Weather protection	Fire resisting construction
201	20 min fire resisting door with smoke seals to BS 476pt 8	Fire alarm actuating point
202	30 min fire resisting door with smoke seals to BS 476pt 8	Fire alarm sounding point
203	30 min fire resisting door with smoke seals to BS 476pt 8	Smoke detector
204	60 min fire resisting door with smoke seals to BS 476pt 8	Heat detector
S.C.	Self closing door	Emergency lighting point
S.C.A.	Self closing door on automatic detector	Normal lighting point
B.S.	Roller shutter door	Actuating switch for normal lighting point
U.O.	Up and over door	Unobstructed exit sign (size in mm)
E	Exit sign (size in mm)	Exit sign in open position
F.L.	Fire lock	Exit sign self-actuating (size in mm)
P.B.	Public bar	Fire alarm panel
M.1	General fire notice	Fire alarm zone indicator panel
M.2	Staff fire notice	Fire alarm zone indicator panel (height in m)
M.3	Fire door keep locked shut	Fire alarm zone indicator panel (height in m)
M.4	Water extinguisher (size in litres)	Fire alarm zone indicator panel (height in m)
M.5	Size and do not foam extinguisher (size in litres)	Fire alarm zone indicator panel (height in m)
M.6	Dry powder extinguisher (size in kg)	Fire alarm zone indicator panel (height in m)
M.7	Hand held carbon dioxide extinguisher (size in kg)	Fire alarm zone indicator panel (height in m)
M.8	Hand held vapourising liquid extinguisher (size in kg)	Fire alarm zone indicator panel (height in m)
M.9	Hand held gas extinguisher (size in kg)	Fire alarm zone indicator panel (height in m)
M.10	Hand held fire blanket (size in m)	Fire alarm zone indicator panel (height in m)
M.11	Fire blanket (size in m)	Fire alarm zone indicator panel (height in m)
M.12	Fire blanket (size in m)	Fire alarm zone indicator panel (height in m)
M.13	Fire blanket (size in m)	Fire alarm zone indicator panel (height in m)
M.14	Fire blanket (size in m)	Fire alarm zone indicator panel (height in m)
M.15	Fire blanket (size in m)	Fire alarm zone indicator panel (height in m)
M.16	Fire blanket (size in m)	Fire alarm zone indicator panel (height in m)
M.17	Fire blanket (size in m)	Fire alarm zone indicator panel (height in m)
M.18	Fire blanket (size in m)	Fire alarm zone indicator panel (height in m)
M.19	Fire blanket (size in m)	Fire alarm zone indicator panel (height in m)
M.20	Fire blanket (size in m)	Fire alarm zone indicator panel (height in m)

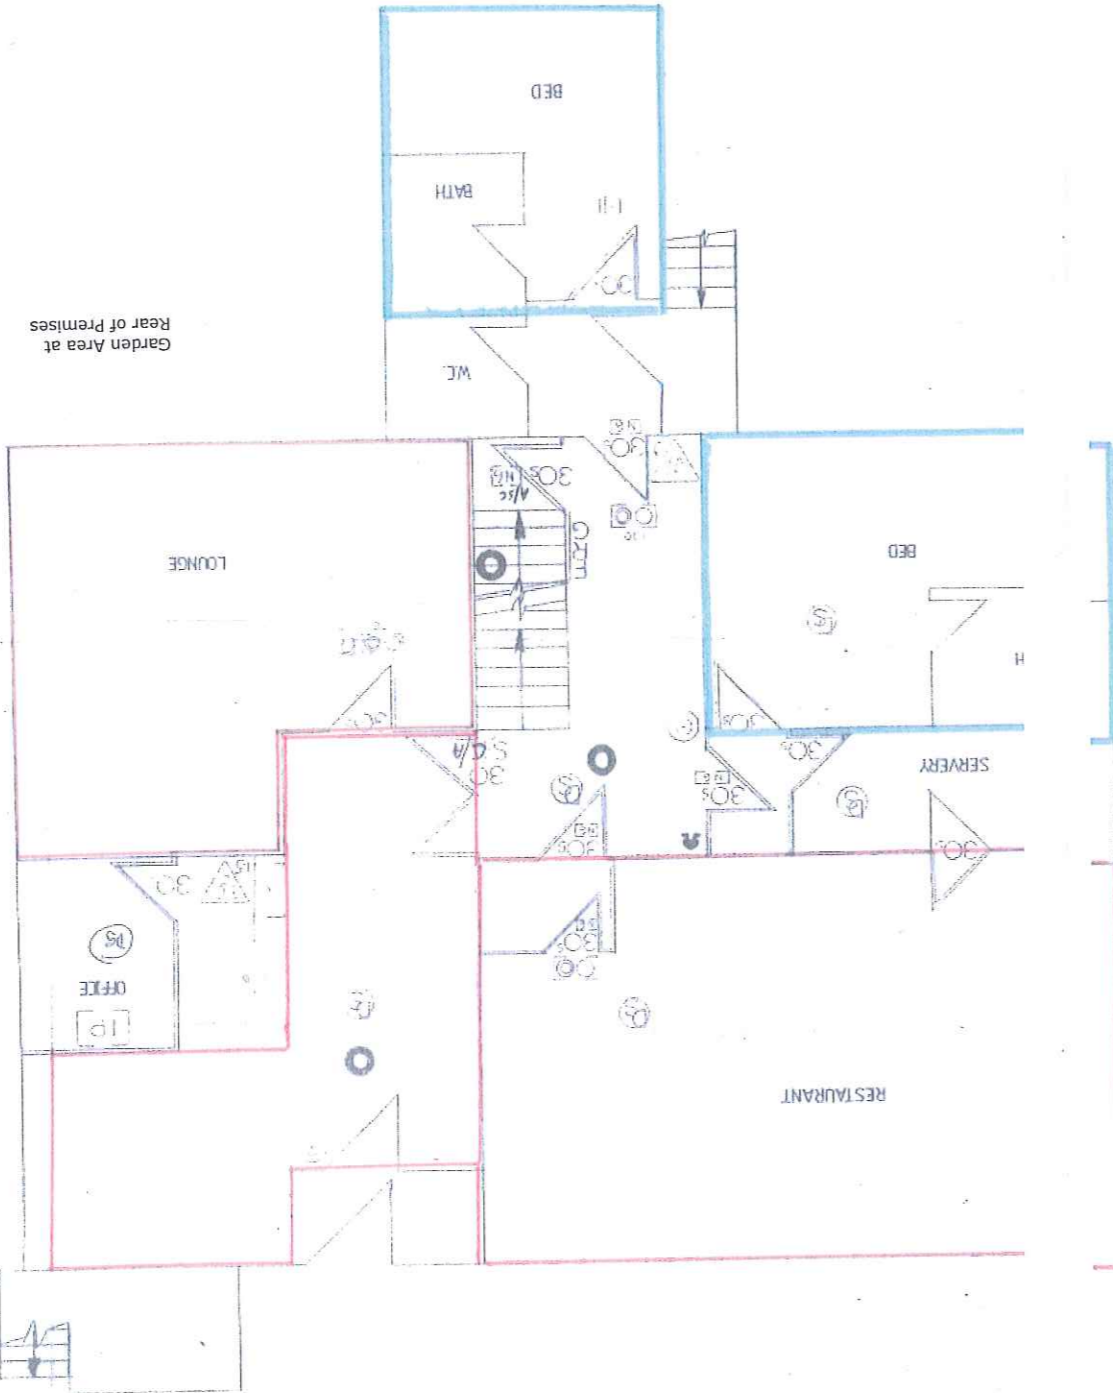

Garden Area at Rear of Premises

Red edged areas for consumption of alcohol, regulated entertainment and late night refreshment, regulated
 Blue area (bedrooms) consumption only
 Bar is the sale of alcohol point

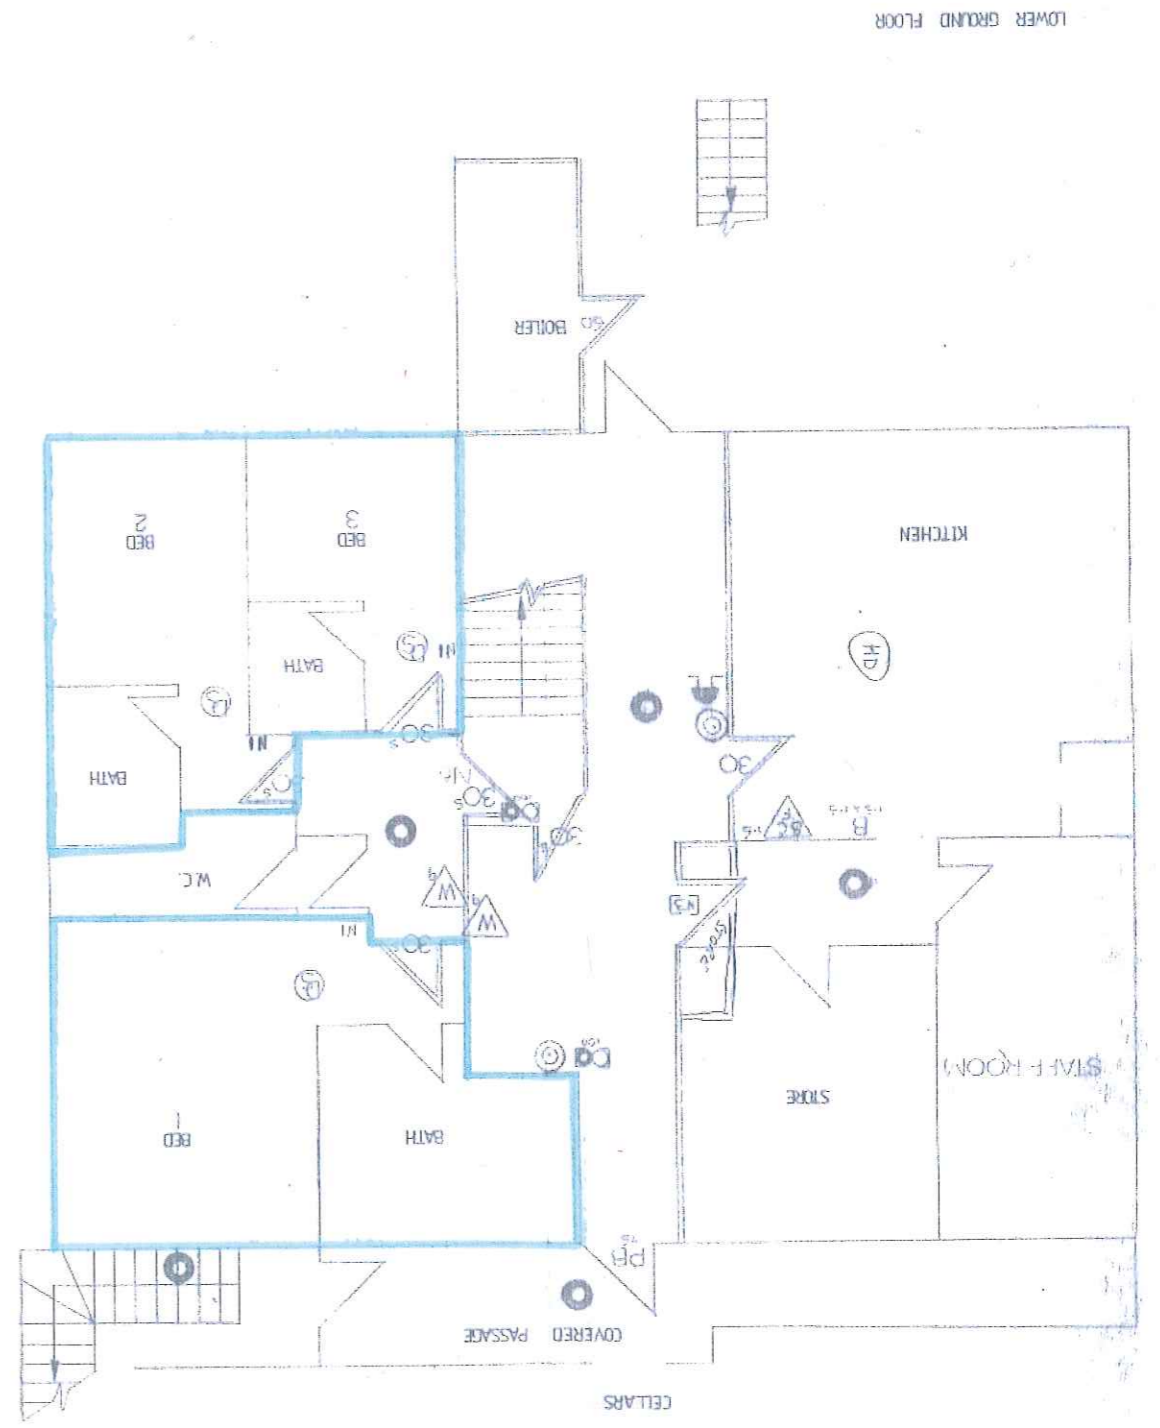

LOWER GROUND FLOOR